Sprinkler Cabinets

1.0 PRODUCT DESCRIPTION

- Victaulic Automatic Sprinkler Cabinets provide for storage of a supply of sprinklers. Maintaining a supply of spare sprinklers on the premises of automatic sprinkler systems will aid in the prompt replacement of operated or damaged sprinklers and returning a fire protection system to service as soon as possible. This is a requirement of NFPA and most Authorities Having Jurisdiction. Refer to the applicable NFPA standard governing your specific installation for further details.
- Six or twelve sprinkler capacity cabinets are available. This also provides for storage of the appropriate wrench which is required for the installation and removal of sprinklers.
- NFPA 25 requires the total number of spare sprinklers to be stored on the premises of an automatic sprinkler system meet the minimum quantities shown in the accompanying table. When the sprinkler system includes more than one type of temperature rating sprinkler, the stock of spare sprinklers must include a proportional sampling of each type and temperature rating; however, a minimum of 3 each is recommended.

Sprinklers in Building	Min. Number of Spare Sprinklers
Under 300	6[1]
300 to 1000	12
Over 1000	24

[1] A minimum of three sprinklers of each type and temperature rating are required for residential fire sprinkler systems in one- and two-family dwellings and mobile homes.

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.

 © 2023 Victaulic Company. All rights reserved.

2.0 CERTIFICATION/LISTINGS

Not applicable – contact Victaulic with any questions.

3.0 SPECIFICATIONS – MATERIAL

Models:

- ☐ 12 sprinklers
- ☐ 6 sprinklers
- ☐ 3 sprinklers (NFPA/3D, Residential)
- ☐ 6 large sprinklers

Material: Heavy gauge steel, red enamel.

Cabinets are available in six or twelve sprinkler capacities with dimensions and shelf variations as shown below. The cabinets are of welded construction fabricated from low carbon steel sheet. The box and shelves are fabricated from 0.030" thick material and the cover is fabricated from 0.042" thick material.

The cover is mounted to the box, at the top, with two 0.036" thick steel butt type hinges. A coat of red enamel paint is applied inside and out, and a label indicating that the cabinet is for spare sprinklers is bonded to the cover.

4.0 DIMENSIONS

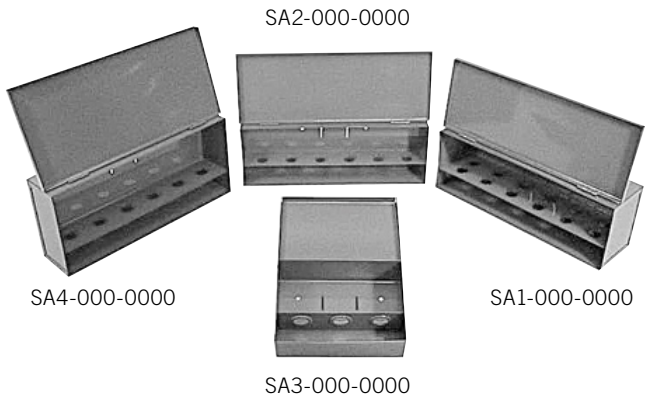

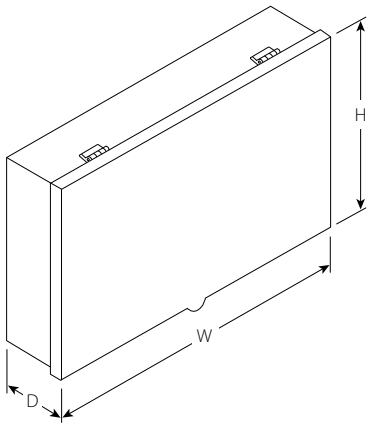

Victaulic Part Number	Description	Use With	Dimensions H inches mm	Dimensions W inches mm	Dimensions D inches mm
SA1-000-0000	For 12 Sprinklers	V10, V26, V27, V34 (except V3403 & V3404)	5.25 133	14.31 364	4.00 102
SA2-000-0000	For 6 Sprinklers	V27, V3403, V3404, V34	5.25 133	14.31 364	2.38 60
SA3-000-0000	For 3 Sprinklers (NFPA 13D)	V27 Residential	5.25 133	7.31 186	2.38 60
SA4-000-0000	For 6 Large Sprinklers	V40, V38, Concealed, K1 ESFR, All Intermediate Level Sprinklers, All Guards[2]	6.50 165	14.31 364	3.13 79

[2] Guards will only fit if **NOT** assembled to sprinkler. Capacity may be reduced.

NOTE

- Specify part number and capacity when ordering.

 © 2023 Victaulic Company. All rights reserved.

5.0 PERFORMANCE

Not applicable – contact Victaulic with any questions.

6.0 NOTIFICATIONS

⚠ WARNING

- **Automatic Sprinkler Cabinets must be installed and the spare sprinkler stock maintained in compliance with the applicable standards of the NFPA, in addition to the standards of any other Authorities Having Jurisdiction.**
- **Wear safety glasses, hardhat, and foot protection.**

Failure to do so may result in property damage and impair the ability to return an automatic sprinkler system to service as soon as possible.

NOTICE

- **The owner is responsible for maintaining a supply of spare sprinklers in proper condition. The installing contractor should be contacted with any questions.**

Failure to do so may result in property damage.

7.0 REFERENCE MATERIALS

Not applicable – contact Victaulic with any questions.

User Responsibility for Product Selection and Suitability
Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, and the applicable building codes and related regulations as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights
No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be constructed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note
This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation
Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

Warranty
Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks
Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.

40.81 2561 Rev C Updated 01/2023 © 2023 Victaulic Company. All rights reserved.